


Honeywell Hydrofluoric Acid



Properties

Honeywell

Corrosion Rates of Carbon Steel Vs. HF Concentration

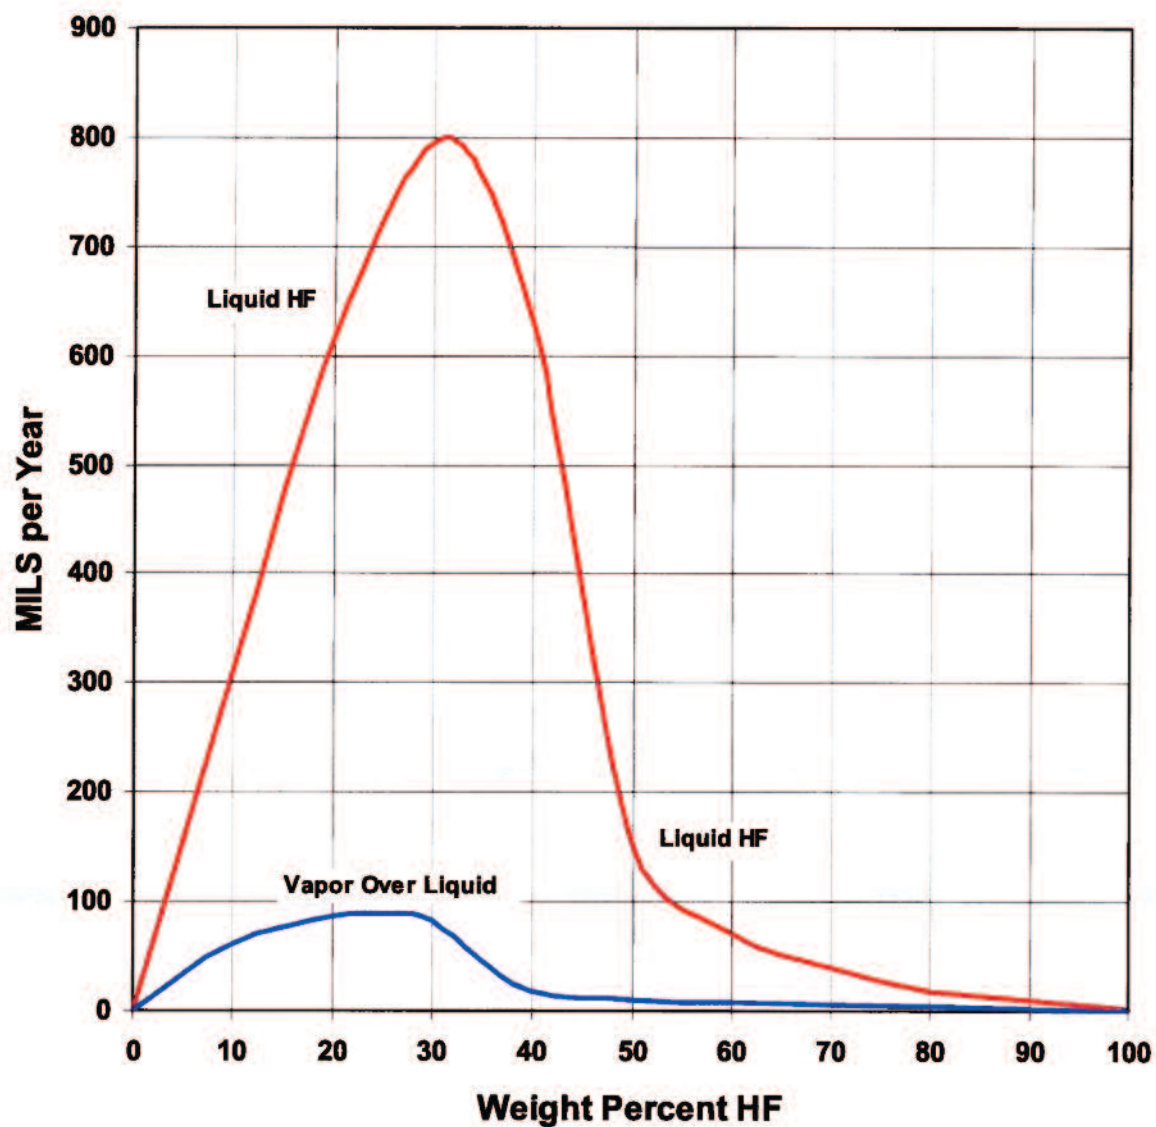

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

Honeywell Fluorine Products

101 Columbia Road


Morristown, NJ 07962-1053

www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Freezing Points of Aqueous Hydrofluoric Acid

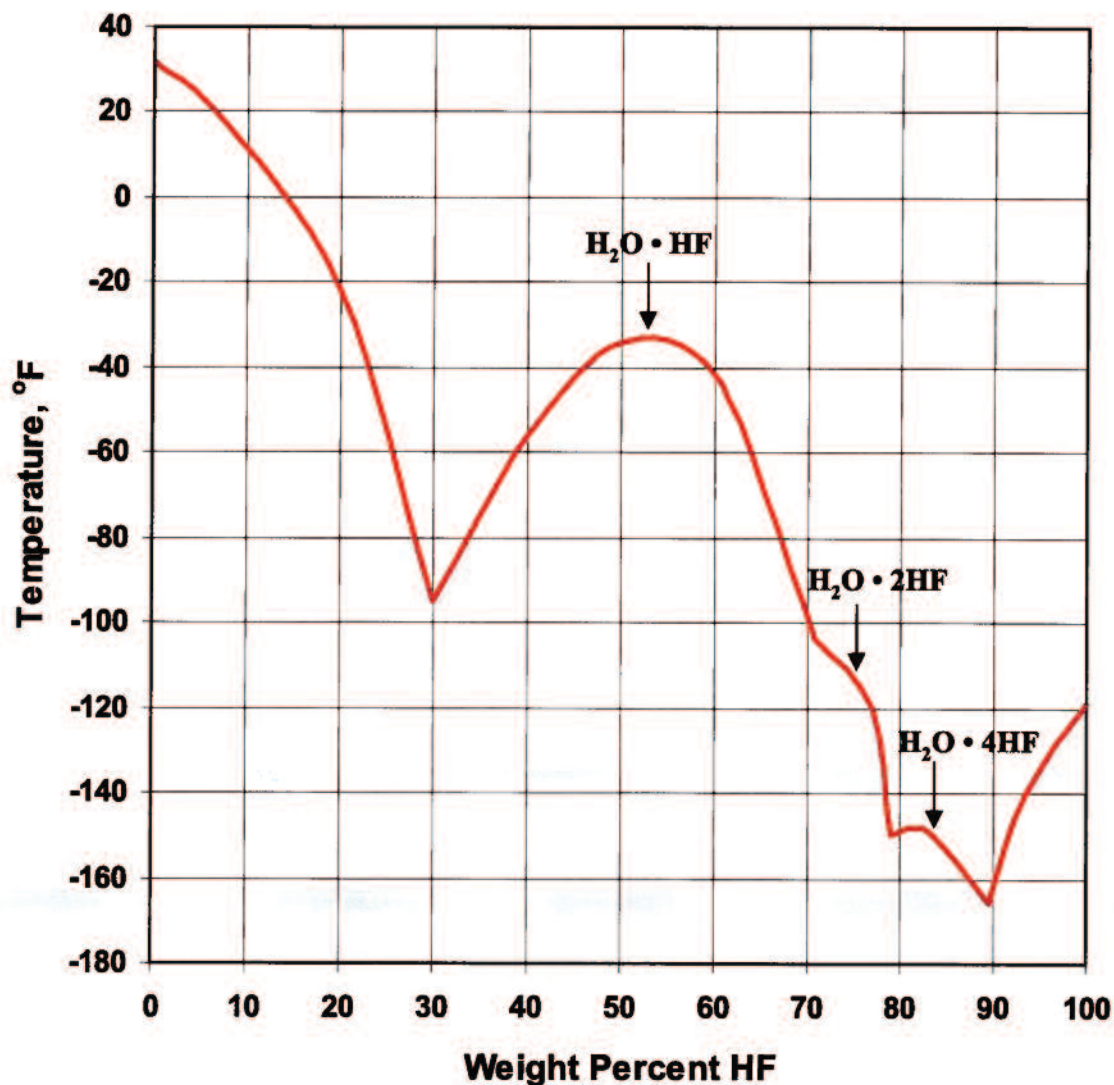


All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



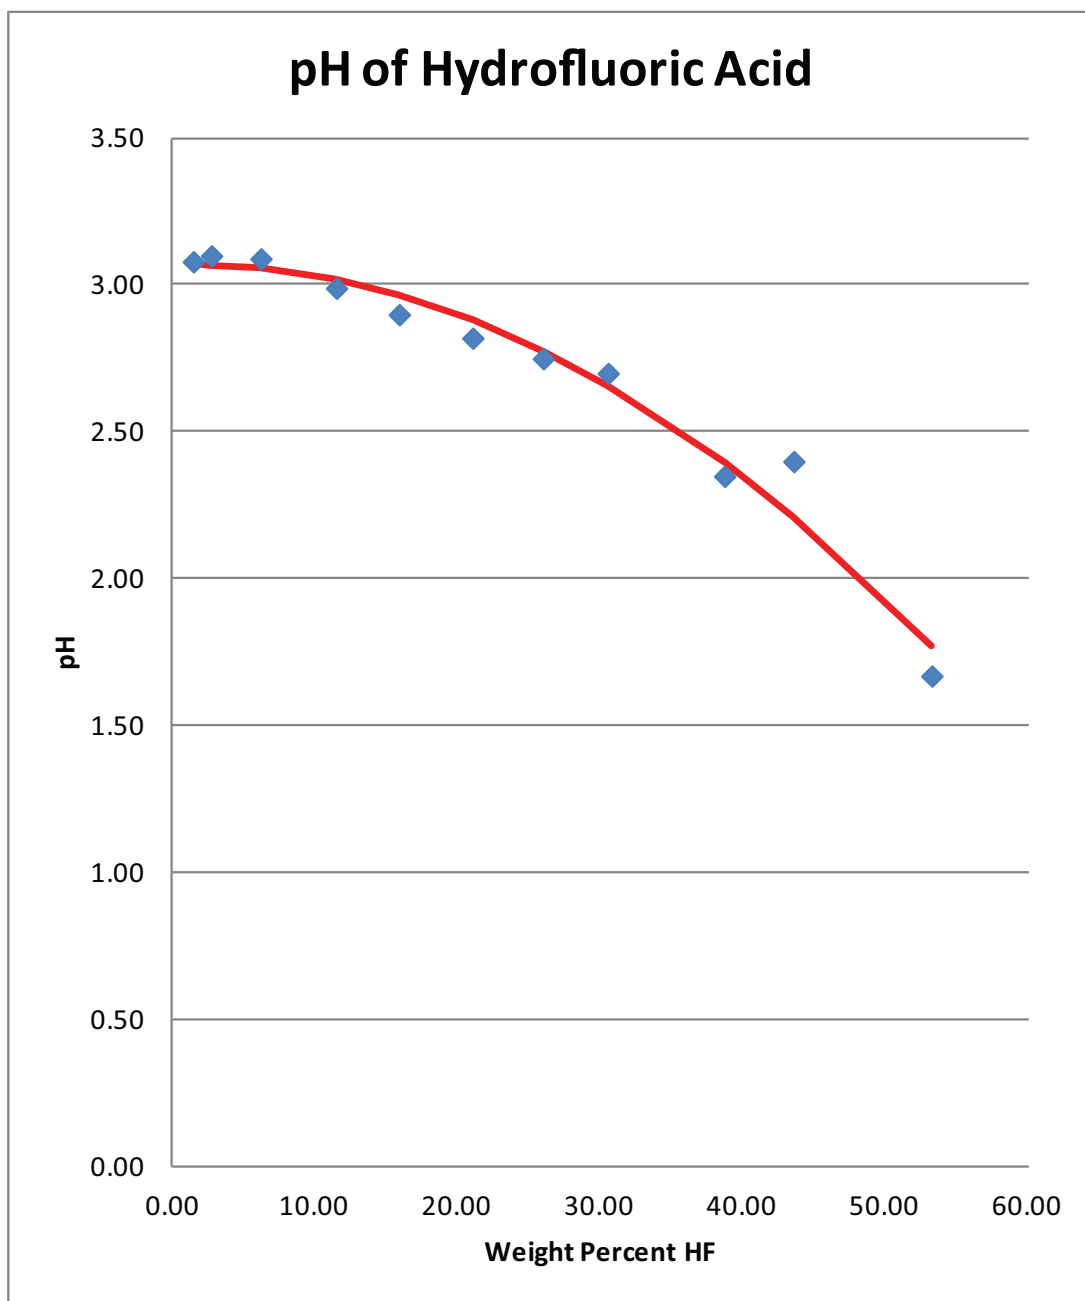

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

March 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Specific Gravity HF-H₂O System

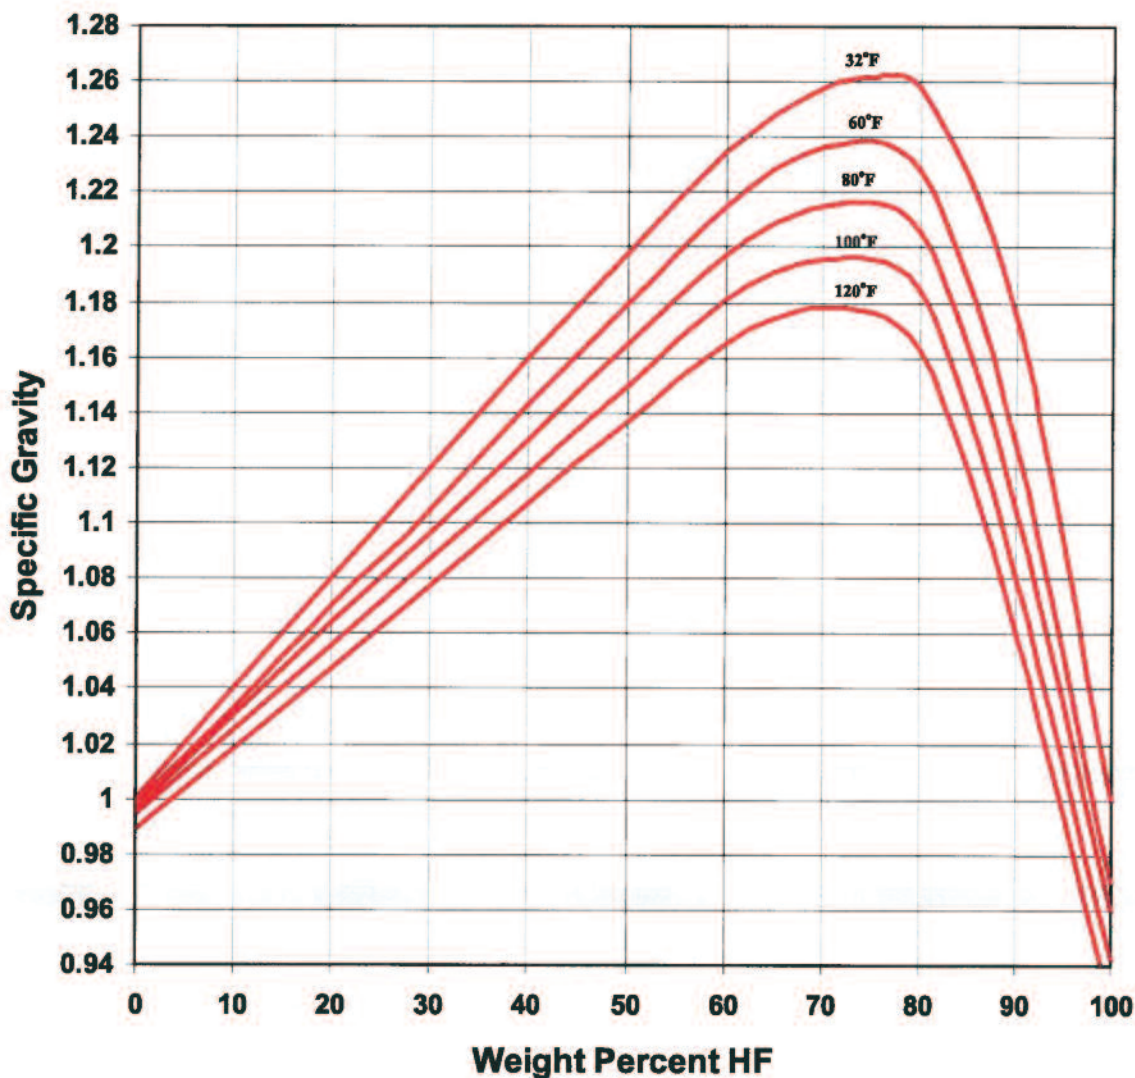

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Density of Anhydrous Hydrogen Fluoride

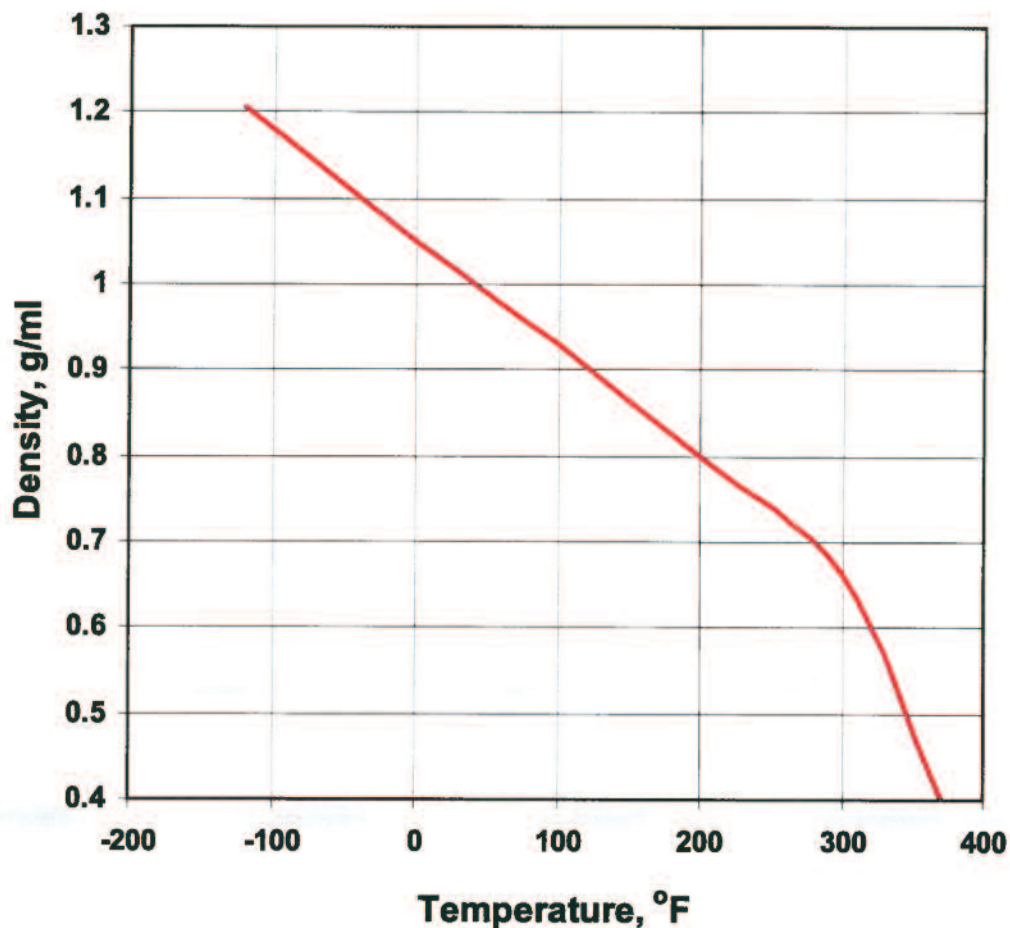

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Apparent Molecular Weight, Hydrogen Fluoride

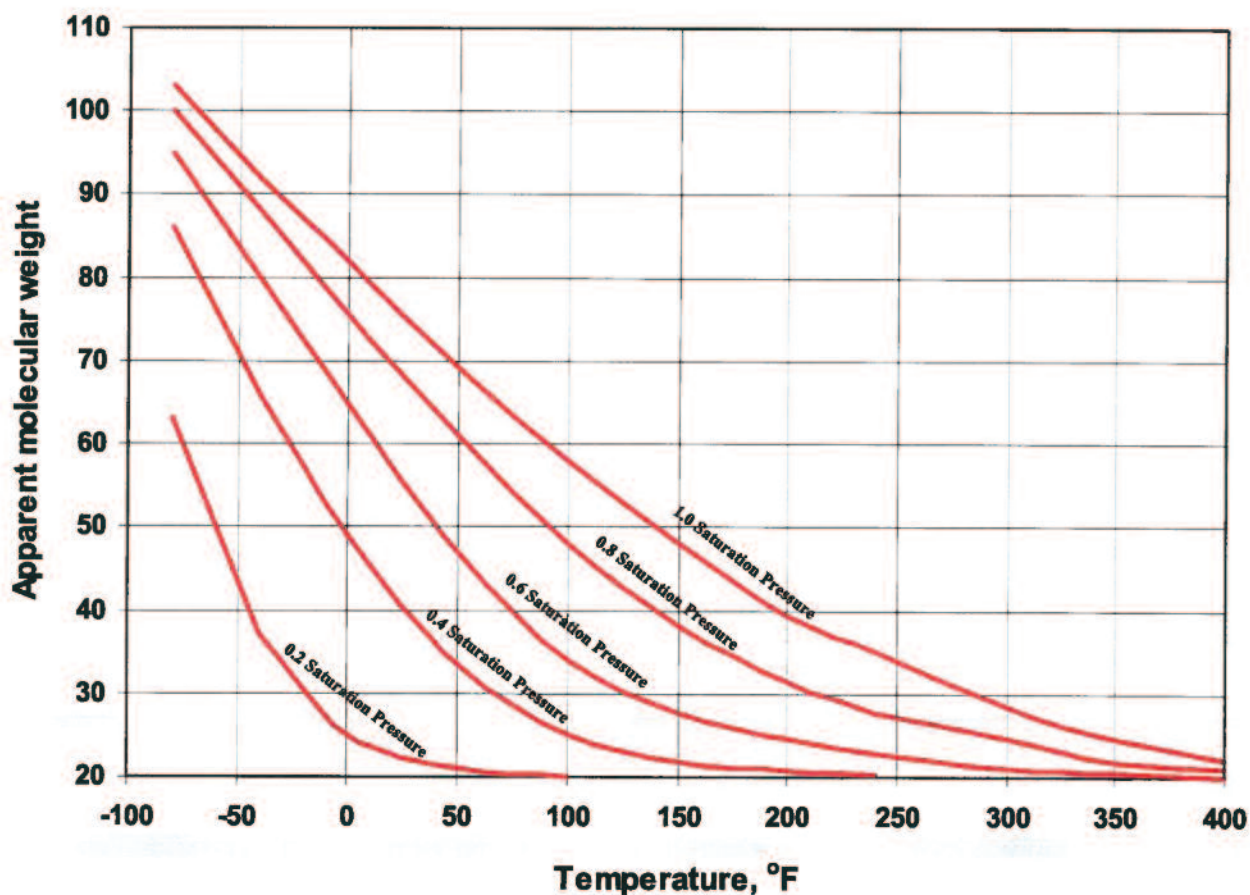

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Boiling Point of HF-H₂O System

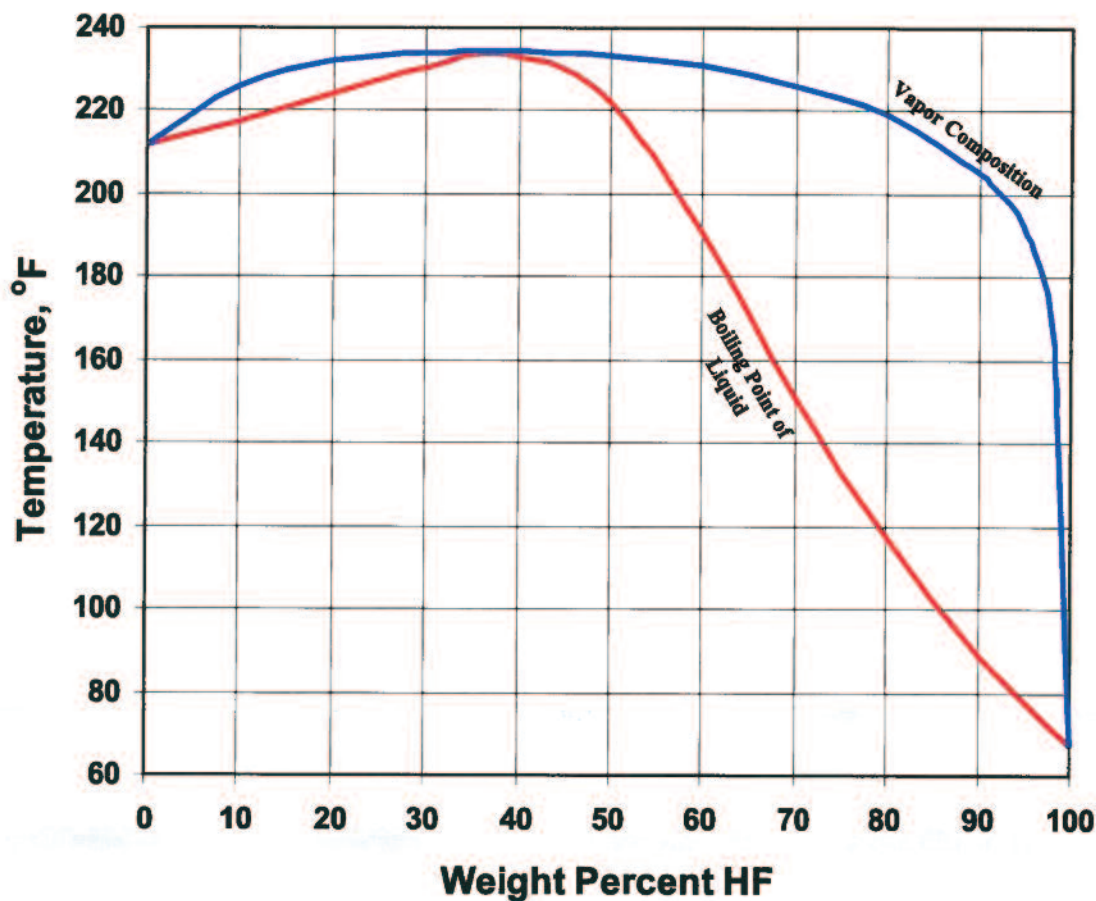

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Partial Vapor Pressure of HF over Aqueous Solutions of HF

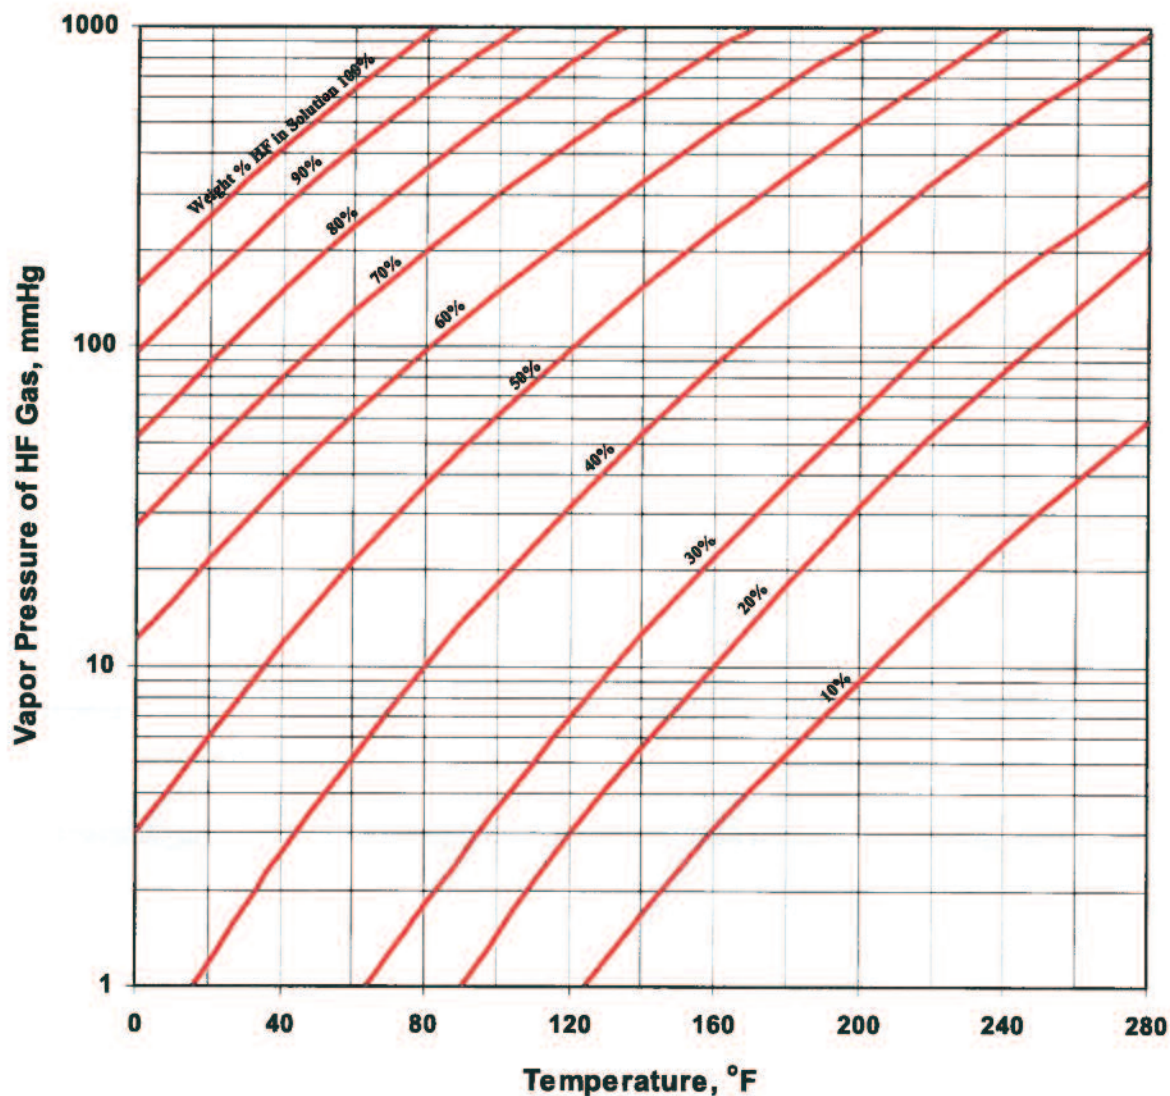

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Vapor Pressure Anhydrous Hydrogen Fluoride

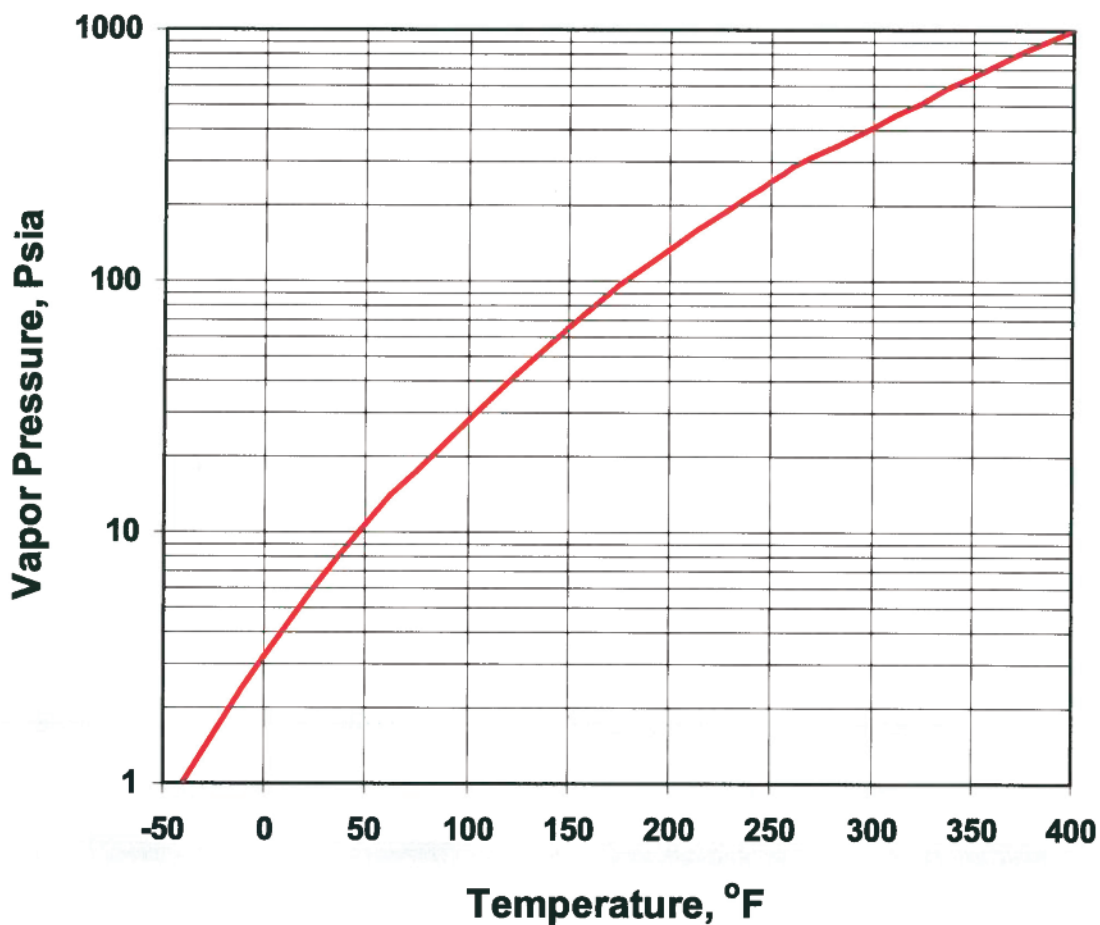

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Vapor Pressure of Anhydrous Hydrogen Fluoride

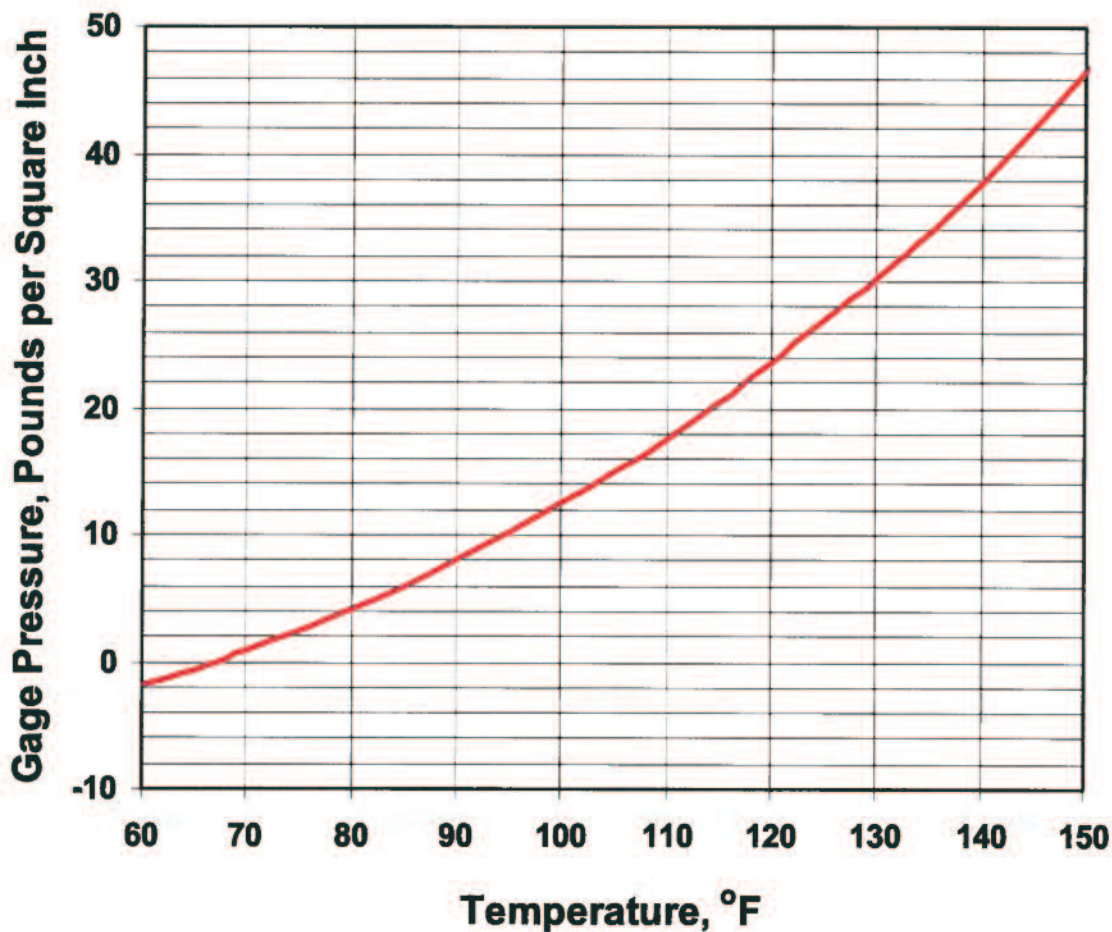

Honeywell Fluorine Products


101 Columbia Road
Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
© 2014 Honeywell International Inc.
All rights reserved



Vapor Liquid Equilibrium Diagram at the Normal Boiling Point

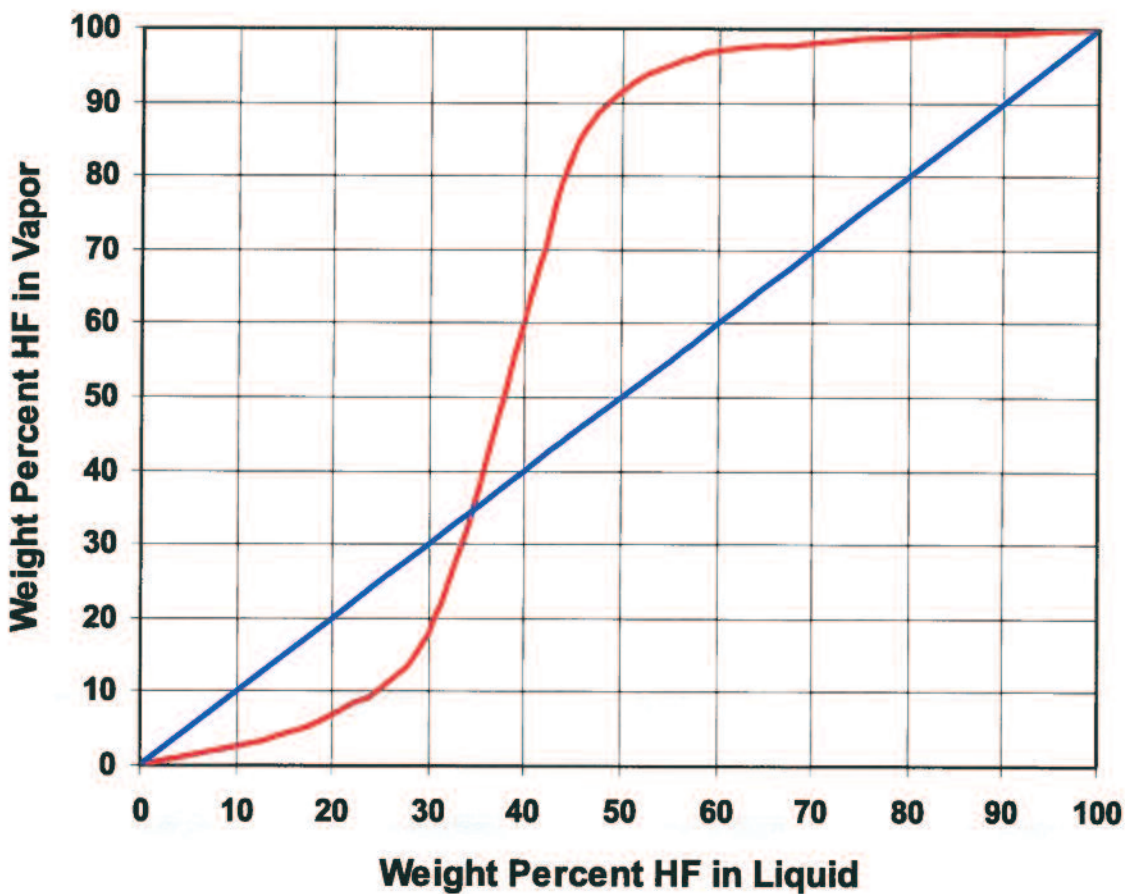

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Specific Volume of HF Gas

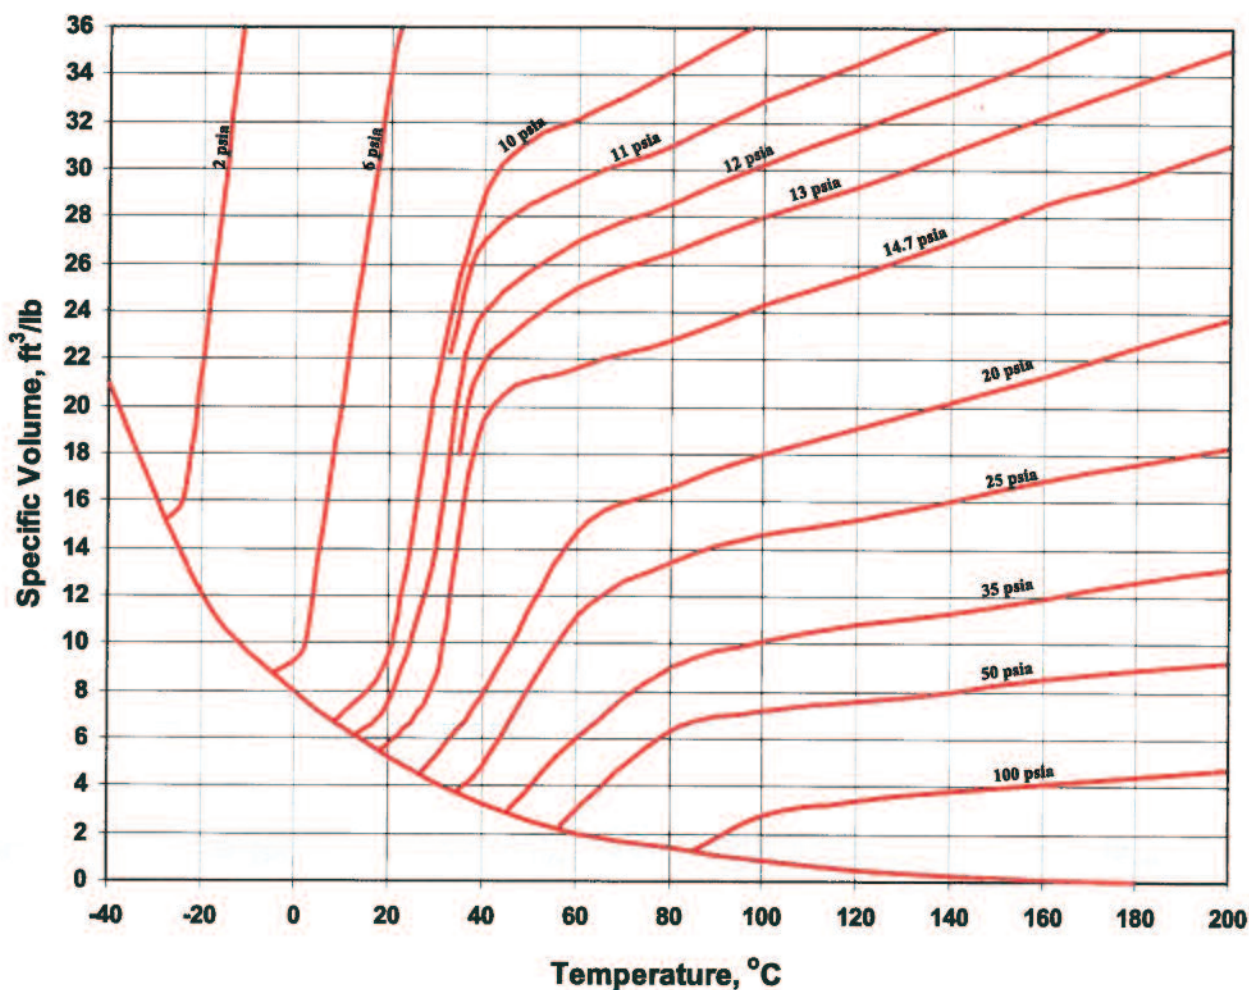

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Heat of Vaporization, Anhydrous Hydrogen Fluoride

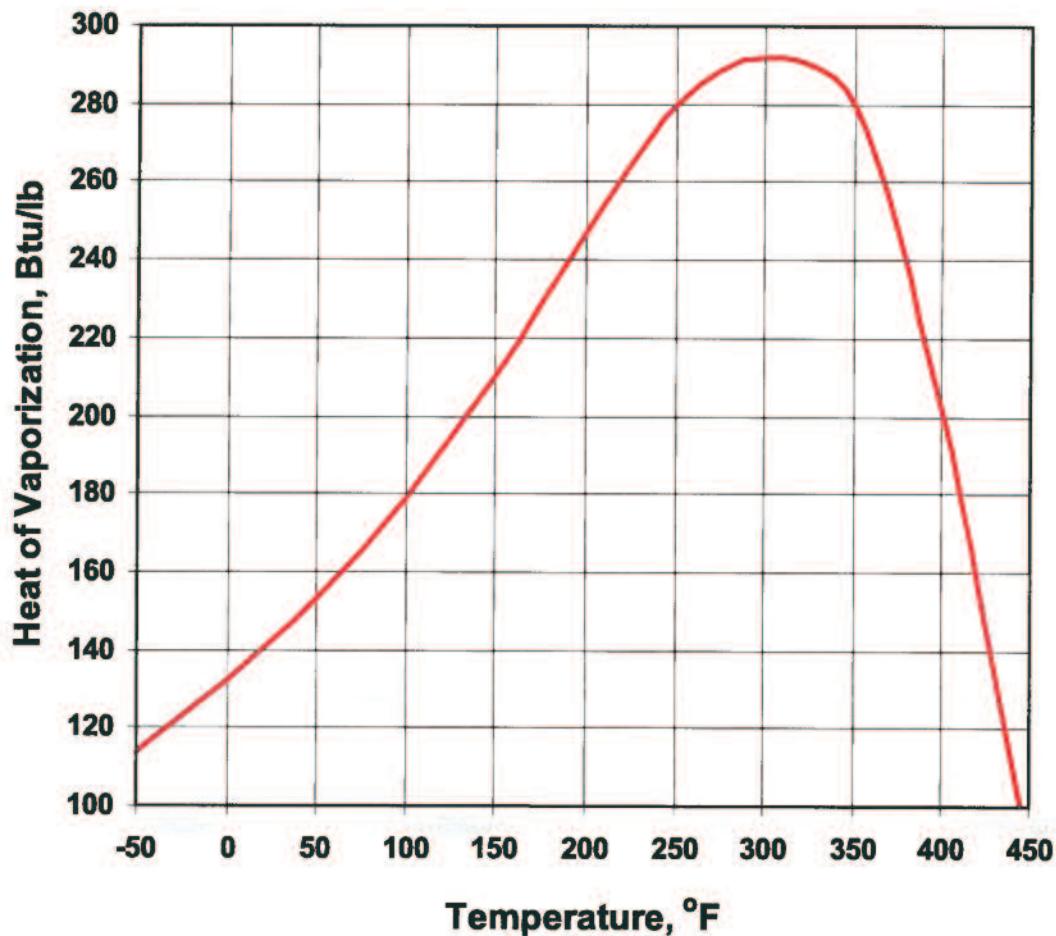

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Specific Heat HF-H₂O System

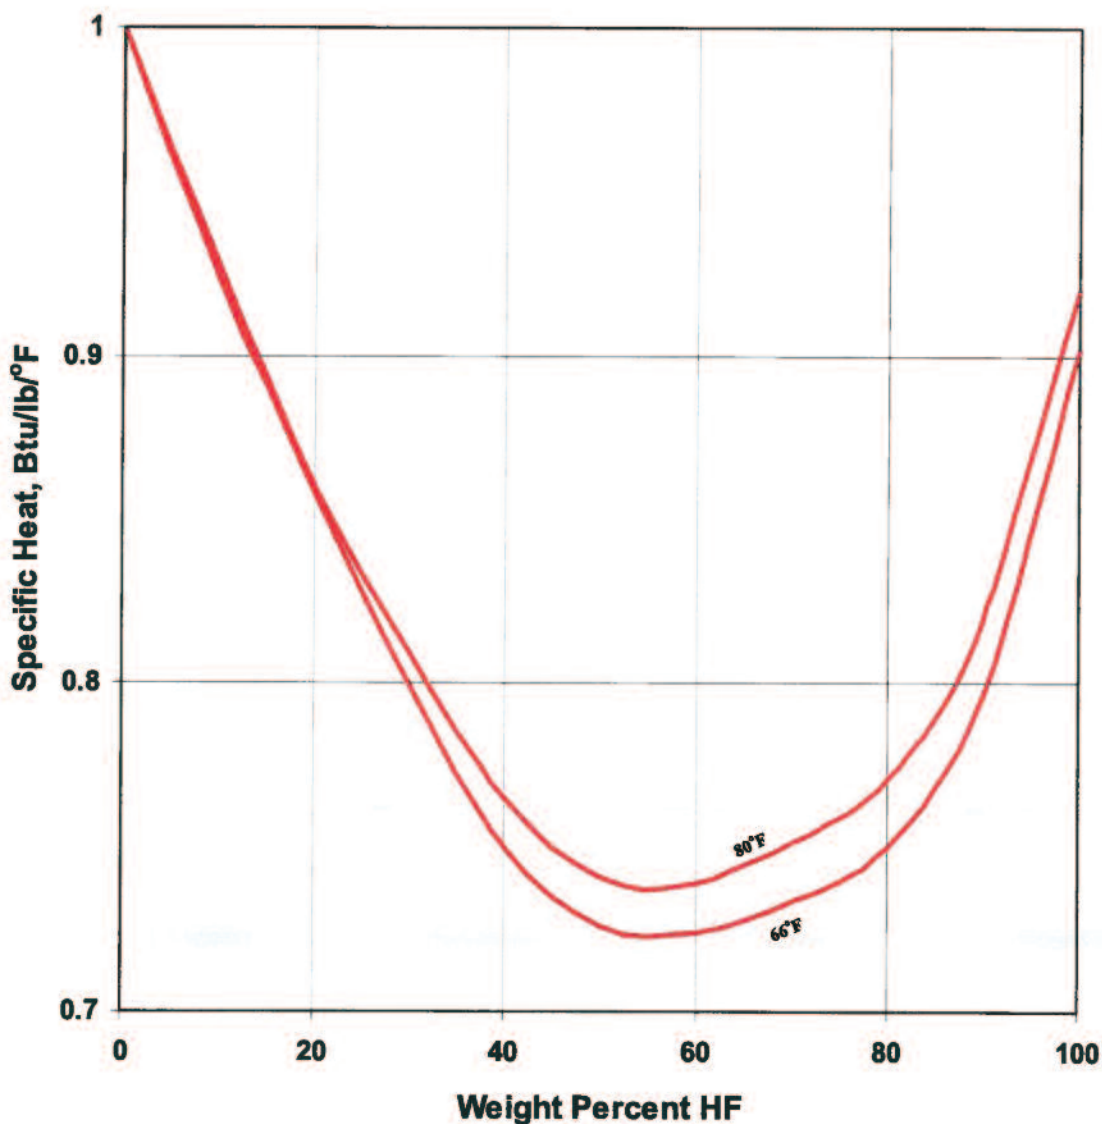

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Specific Heat Liquid AHF

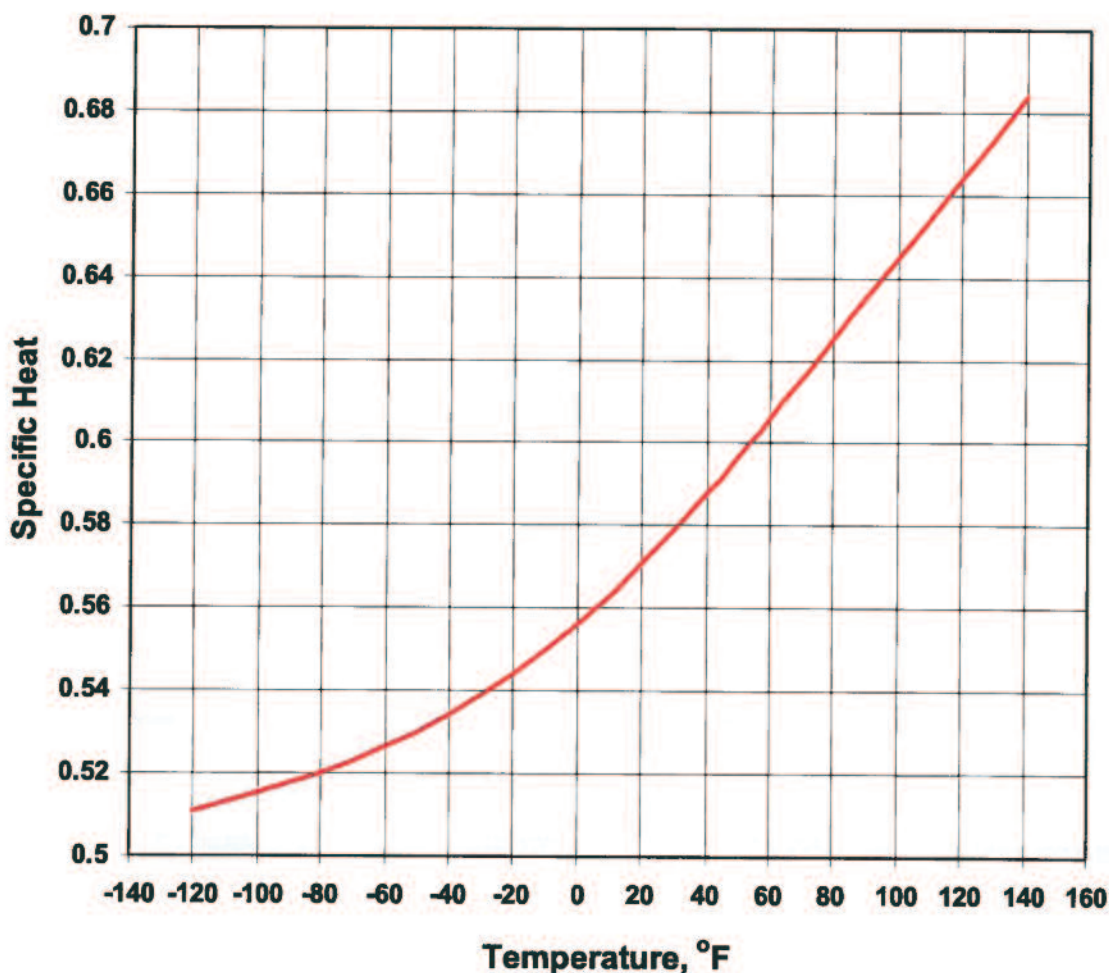

Honeywell Fluorine Products


101 Columbia Road
Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
© 2014 Honeywell International Inc.
All rights reserved



Enthalpy Hydrogen Fluoride Gas

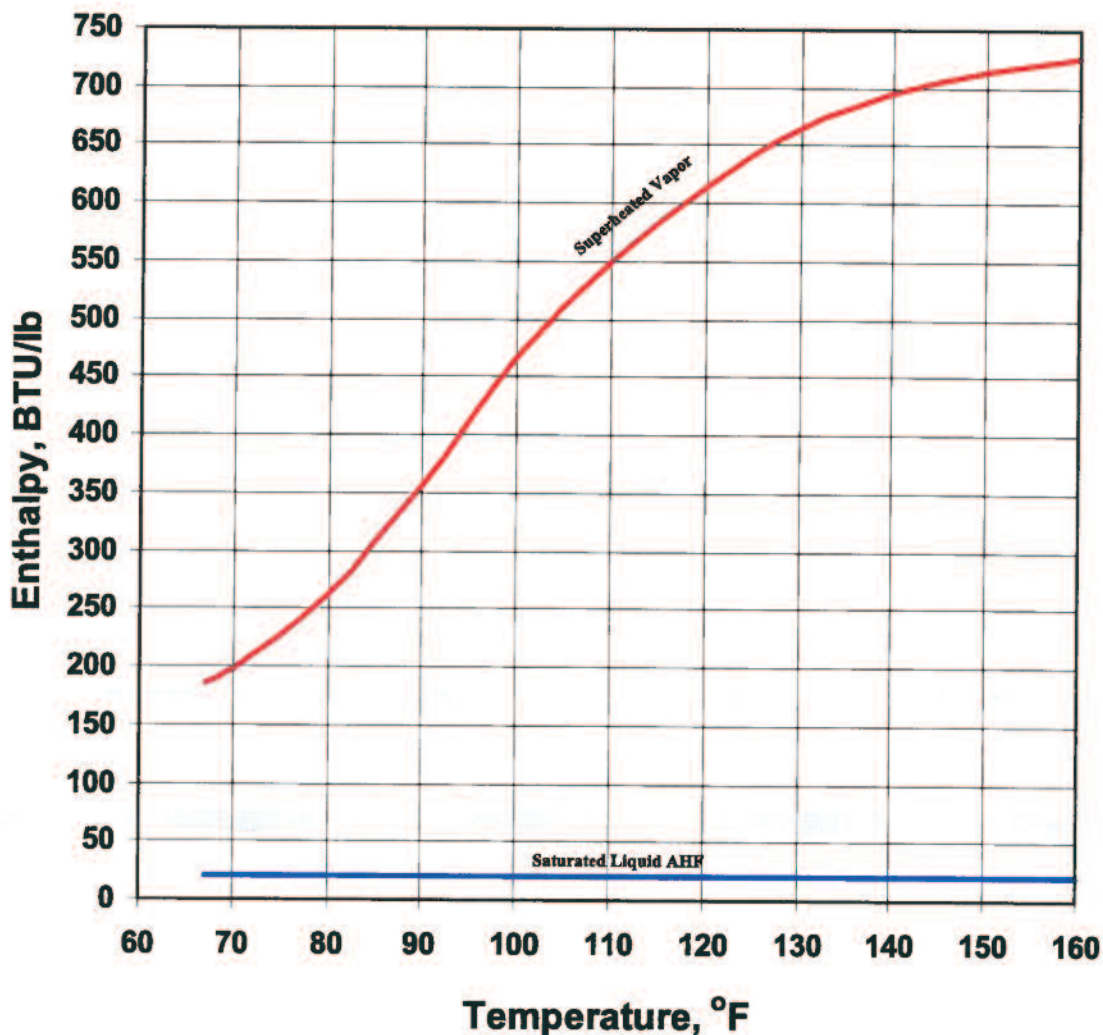

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Enthalpy Concentration Chart for HF- H₂O System at 1 Atm

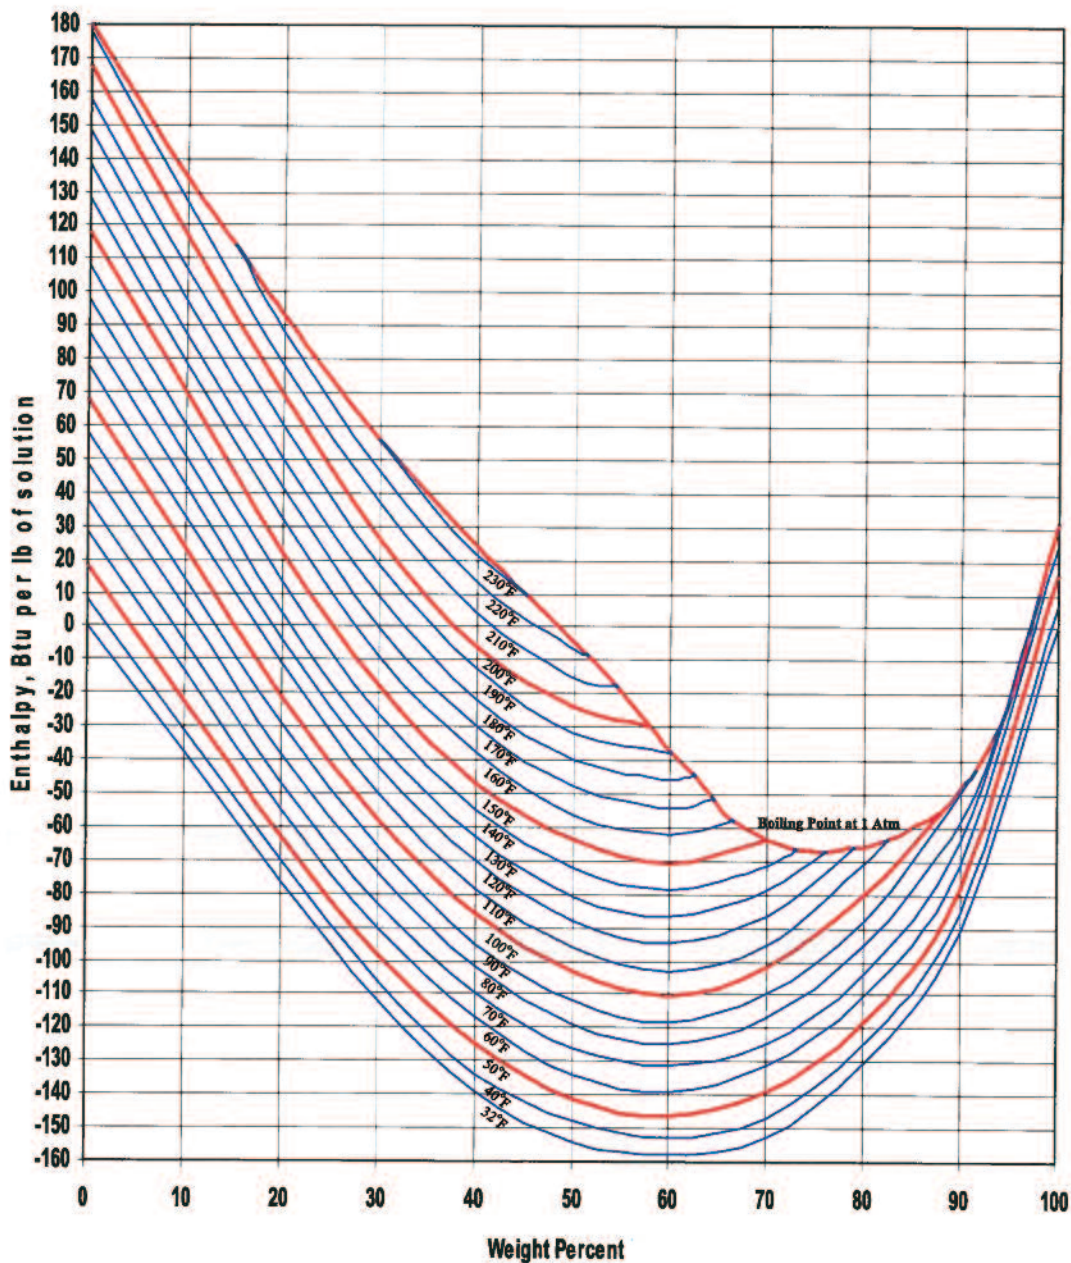

Honeywell Fluorine Products


101 Columbia Road
Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
© 2014 Honeywell International Inc.
All rights reserved



Hydrogen Fluoride, Temperature Vs. Enthalpy

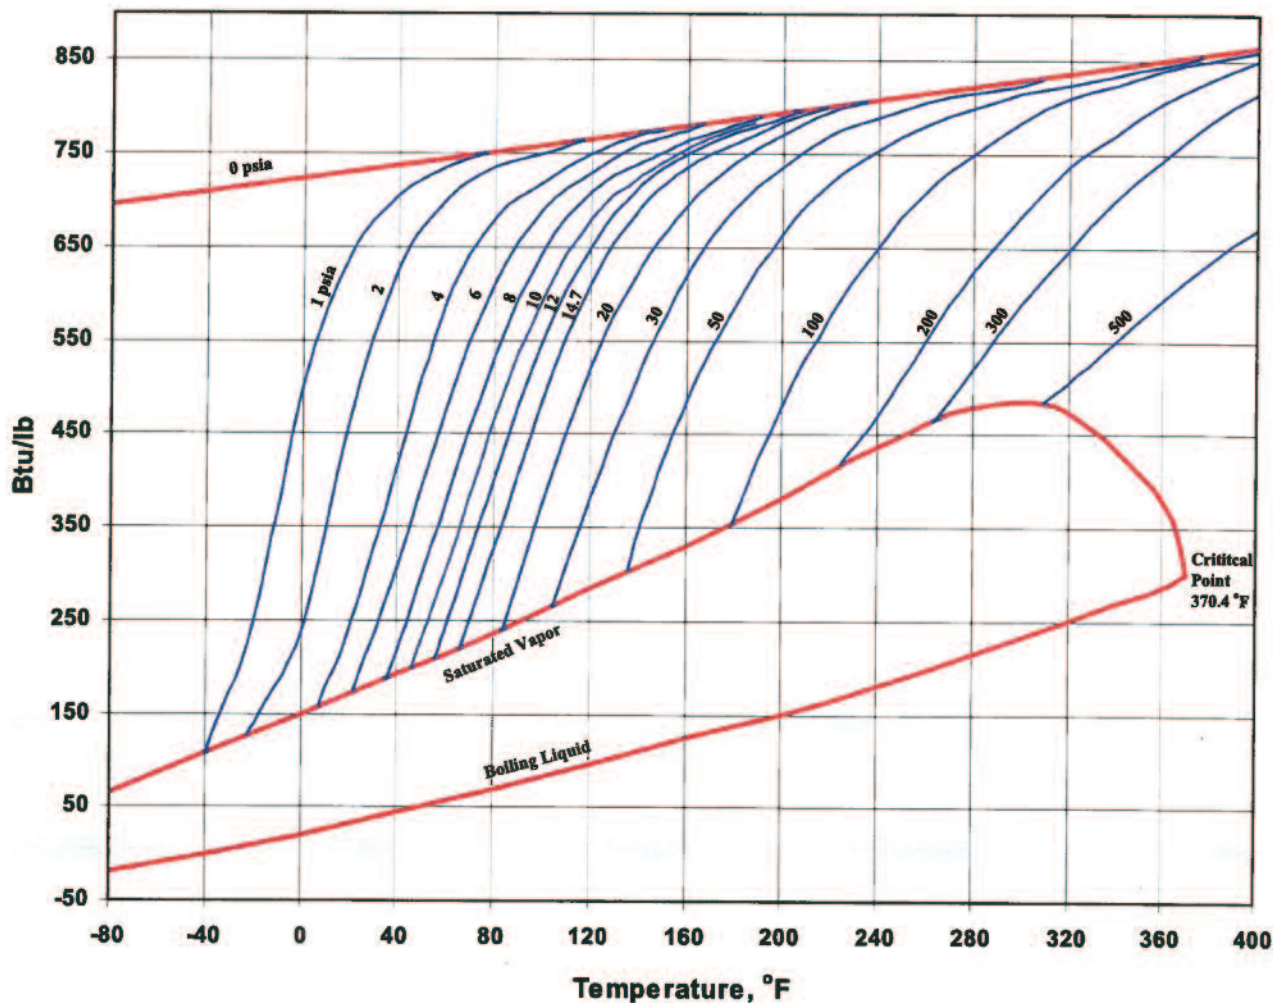

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Heat of Dilution for Anhydrous Hydrogen Fluoride

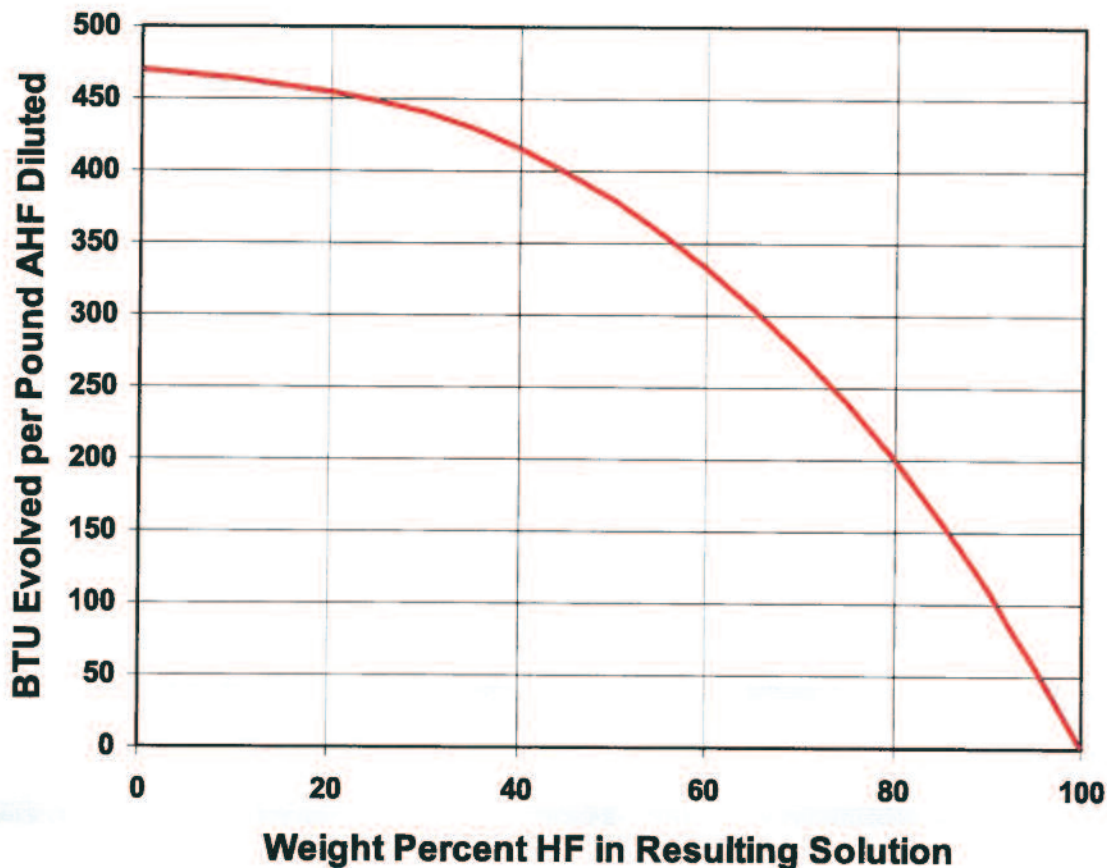

Honeywell Fluorine Products


101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Viscosity of HF Gas

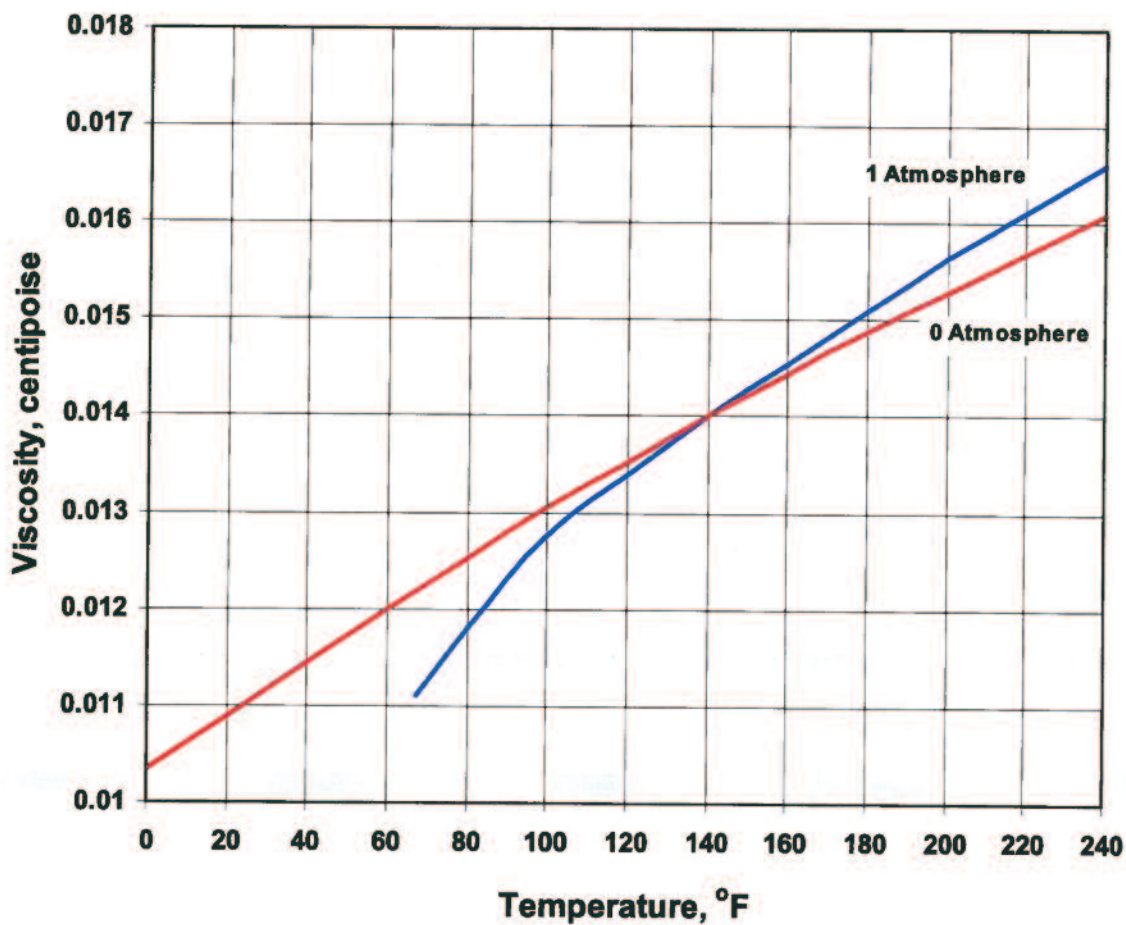

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Viscosity of Commercial Anhydrous Hydrofluoric Acid

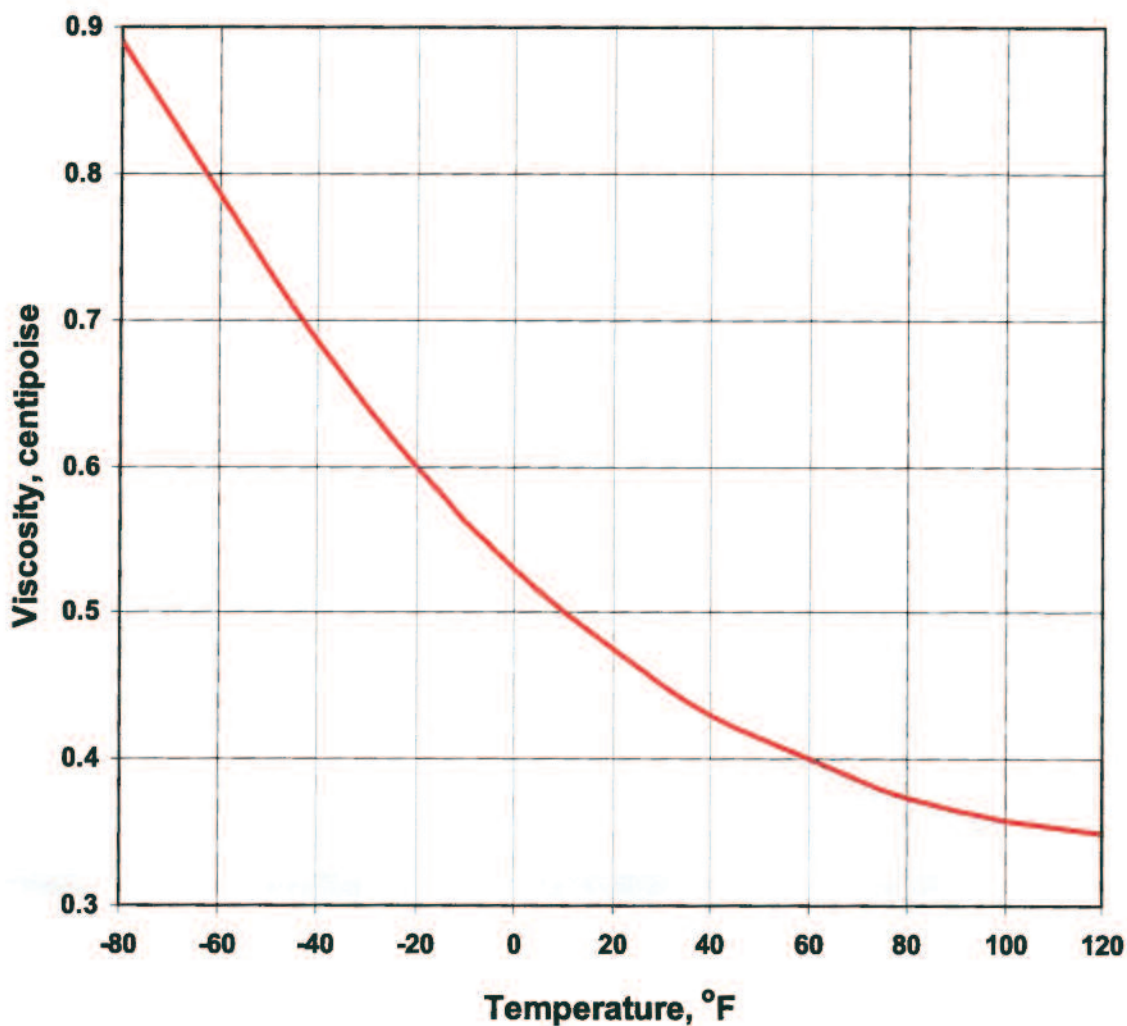

Honeywell Fluorine Products

101 Columbia Road

Morristown, NJ 07962-1053


www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
© 2014 Honeywell International Inc.
All rights reserved



Viscosity of HF-H₂O System

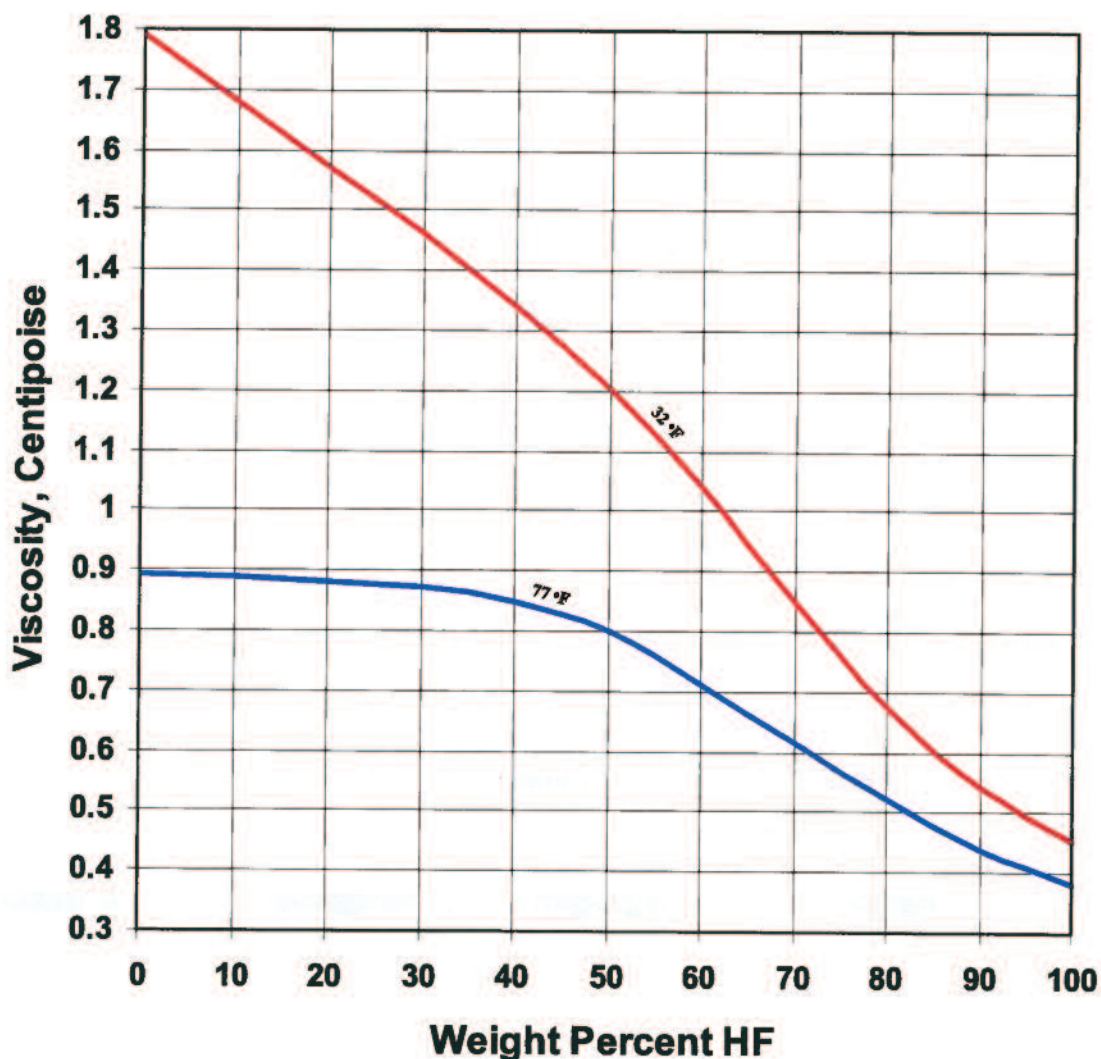

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



Thermal Conductivity of Anhydrous Hydrogen Fluoride

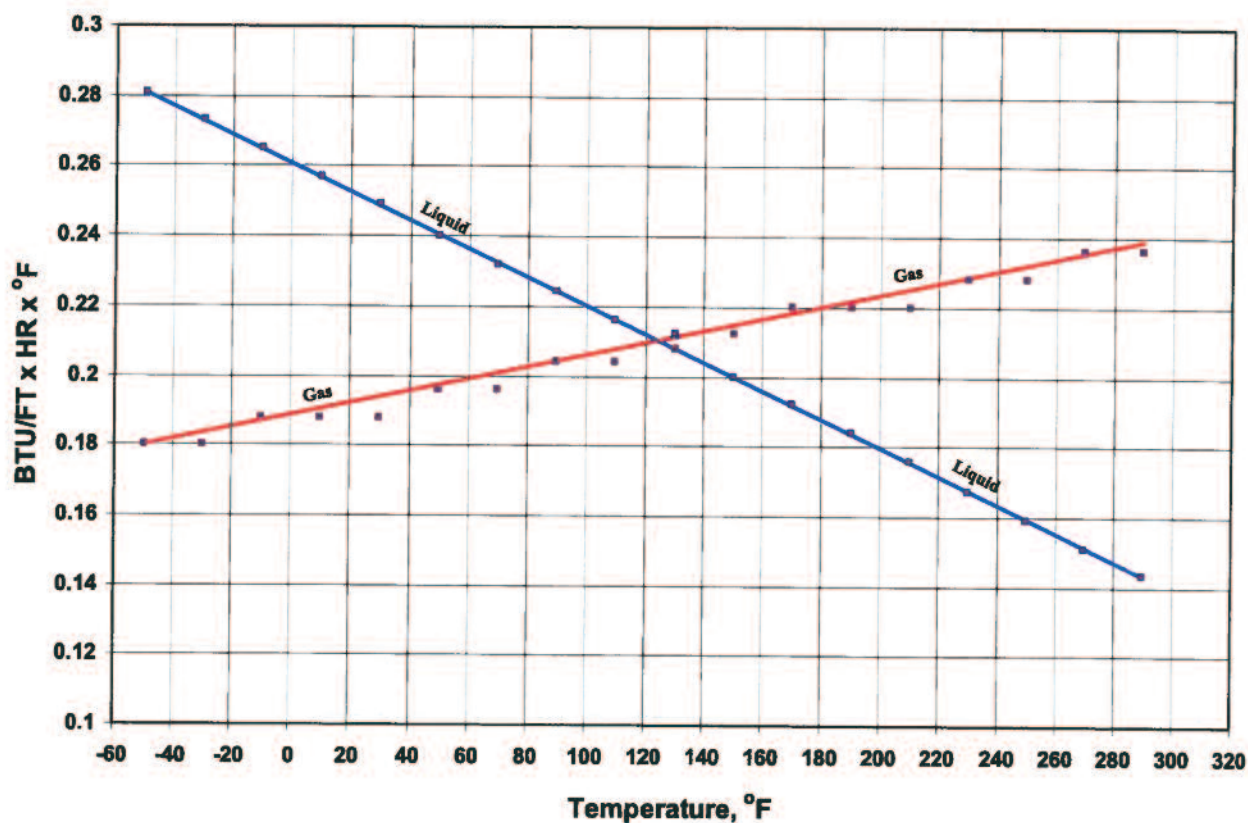


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

January 2014
 © 2014 Honeywell International Inc.
 All rights reserved



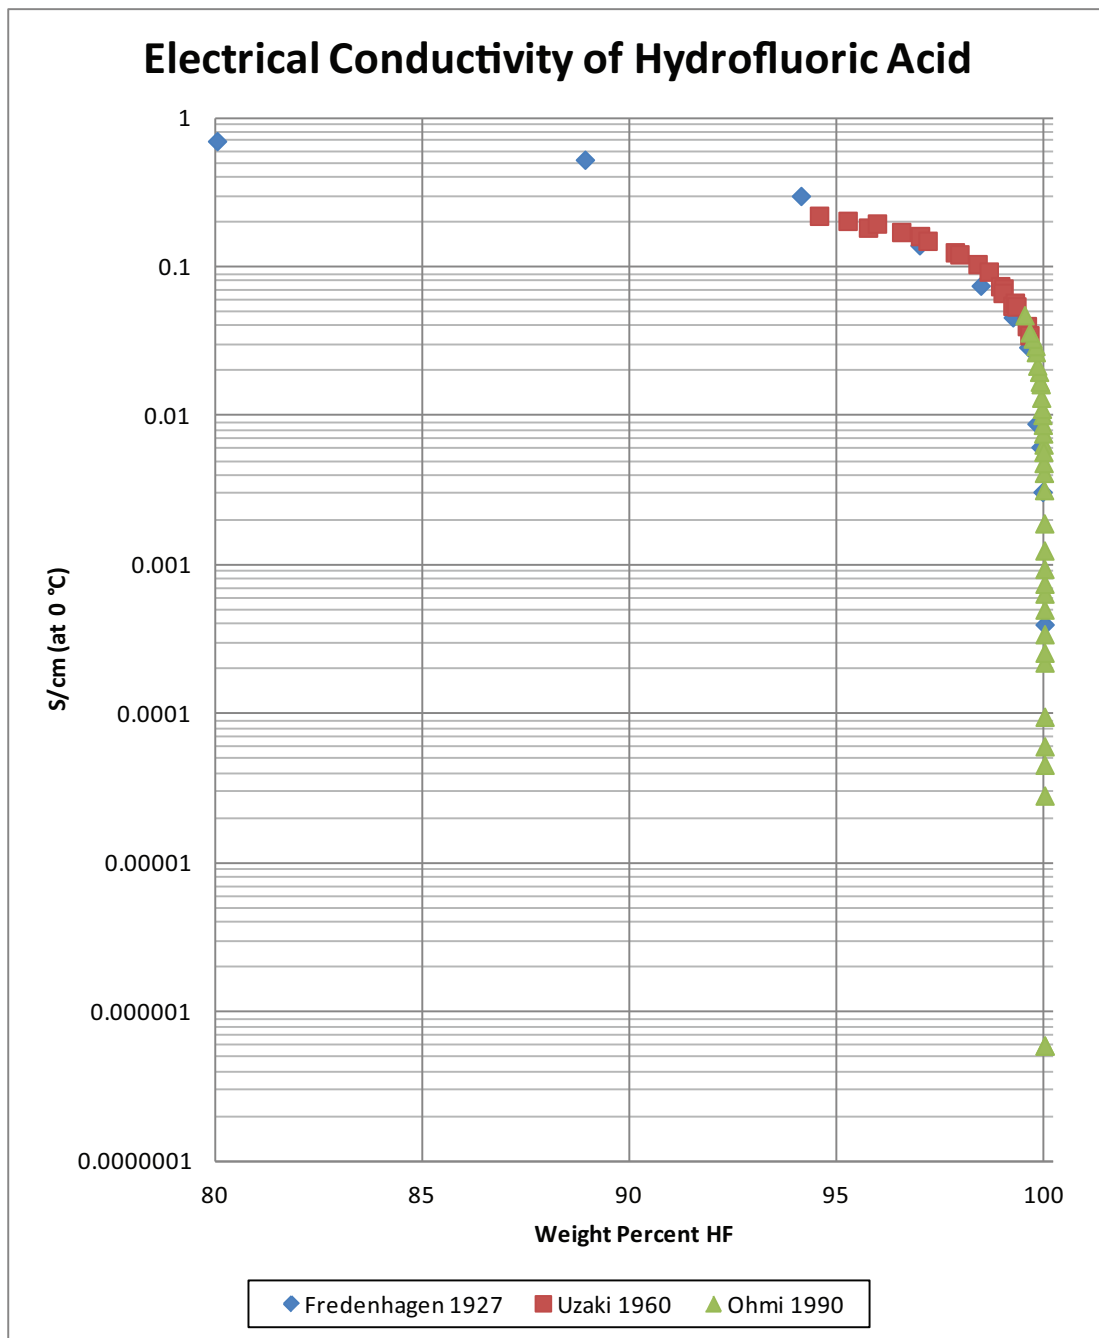


Honeywell Fluorine Products

101 Columbia Road
 Morristown, NJ 07962-1053
www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

March 2014
 © 2014 Honeywell International Inc.
 All rights reserved



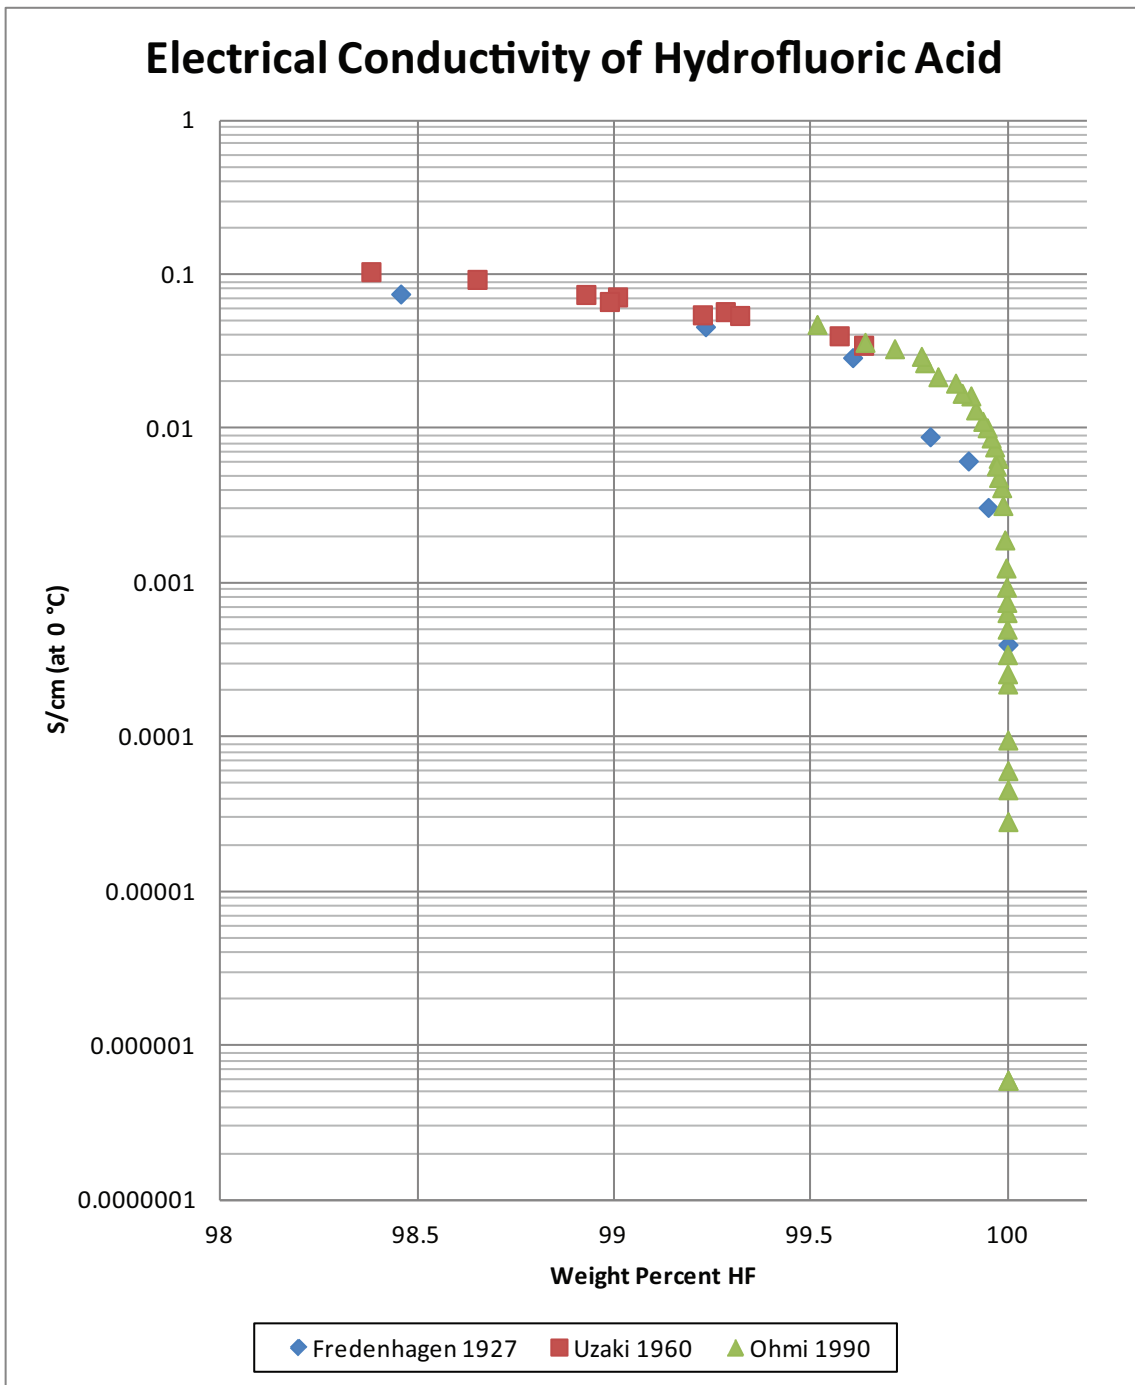

Honeywell Fluorine Products

101 Columbia Road

Morristown, NJ 07962-1053

www.hfacid.com

All statements, information and data given herein are believed to be accurate and reliable, but are presented without guarantee, warranty or responsibility of any kind, express or implied. Statements or suggestions concerning possible use of products are made without representation or warranty that any such use is free of patent infringement, and are not recommendations to infringe any patent. The user should not assume that all safety measures are indicated herein, or that other measures may not be required. The values presented herein are typical values and are not to be interpreted as product specifications. User assumes all liability for use of the information and results obtained.

March 2014
 © 2014 Honeywell International Inc.
 All rights reserved

